



Installation & Operating Instructions




Universal Remote Emergency Pack

Part code: EMLEDKITND-1

Product Specification

- Mains voltage:	230V +/- 10%
- Mains frequency:	50 - 60Hz
- Power Consumption (Excluding external Driver):	4VA
- 2 x user-serviceable fuses internal fuses:	'T' 2A 5x20mm
- Emergency output voltage range:	(See product label)
- Emergency Duration:	(See product label)
- Battery:	(See product label)
- Ambient temperature range:	+5°C to +35°C
- Weight	0.7kg
- Charging time:	24 hours
- Protection class:	1
- Degree of protection:	IP20
- Material:	UL94 V0 Polycarbonate
- Em module complies with:	BS EN 61347-2-7/2-13
- Suitable for installation to EN50172 and BS7671	

NOTE – To comply with regulations, installation must be carried out by suitably qualified competent person and in accordance with the current IEE wiring regulations (BS7671) and building regulations. The emergency pack requires 2 live feeds, A permanent supply for charging the battery pack and 1 for switching of the lamp.

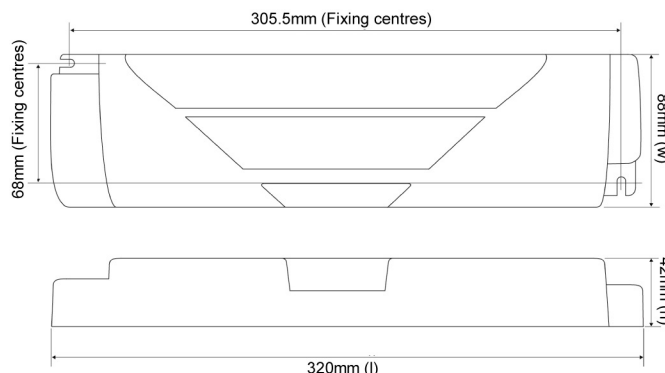

Features

- > For use with LED panels, arrays or down lights of compatible voltage.
- > External battery connector for simple isolation
- > 3-pole isolation of lamp & mains driver power during emergency
- > Contains replaceable 3 x 4Ah Nickel Cadmium (NiCd)
- > Emergency output power (Typical) : 3W (3-cell)
- > 1 or 3-hour autonomy (See product label)

Installation

Ensure the mains supply is isolated before attempting installation!

Please refer to page 2 of this leaflet for mains supply, driver and lamp connections. Once wiring is complete, use both internal cable clamps to secure cables in place and to prevent unauthorised access, ensure the lid is fixed in place using the screw on the base. If external plug and socket connectors are used without means to prevent accidental disconnection, the remote box should be sited so that it is protected from unauthorised disconnection.

A recessed mount can be found inside the packaging carton to assist installation of the indicator LED. A 14-16mm hole should be drilled in the required location so it is visible during normal use. Once installed, the indicator LED will be illuminated and the supply should be left undisturbed for a minimum of 24 hours to charge the batteries before attempting a commissioning test. After a successful test, the date should be noted on the space provided on the battery.

A service record is provided on page 2 of this document for recording subsequent tests.

Standard / single colour (green) shows the following condition:

A green LED shows the following conditions:

- LED green: mains OK and battery connected
- LED off: Mains failure [below 160V], battery disconnected/ battery faulty or faulty unit.

Emergency Lighting 'standard' or 'manual' Test

The following minimum inspections and tests should be carried out:

Monthly

Switch off the mains power supply to the lighting unit. Inspect all emergency lights for satisfactory operation. Any defects should be noted and actioned by a competent person as soon as possible.

Yearly

Switch off the mains power supply to the lighting unit. Leave the unit to run for the rated period (e.g. three hours). The lights should remain operable from the battery for the whole period.

Please be aware that further inspection / testing may be required, e.g. by risk assessment / local legislation.

Batteries and Disposal

The battery has a designed service life of 4 years and must be replaced in a timely manner to ensure the integrity of the emergency lighting system is maintained. In any case, the battery should be replaced when it no longer provides the rated duration (3 hours).


The manufacturer of the enclosure is committed to fulfil its obligations as a producer of batteries used in emergency lighting applications. End-of-life batteries may either be returned to the remote enclosure manufacturer at the customers cost and arrangements will be made to ensure their correct disposal. Alternatively it may be more convenient for the customer to deliver end-of-life batteries to site(s) of authorized treatment facilities at their cost and it will be ensured that they are accepted back and subsequently treated to the standard required by the regulations.



Installation & Operating Instructions

EMLEDKITND-1

Internal Wiring connections

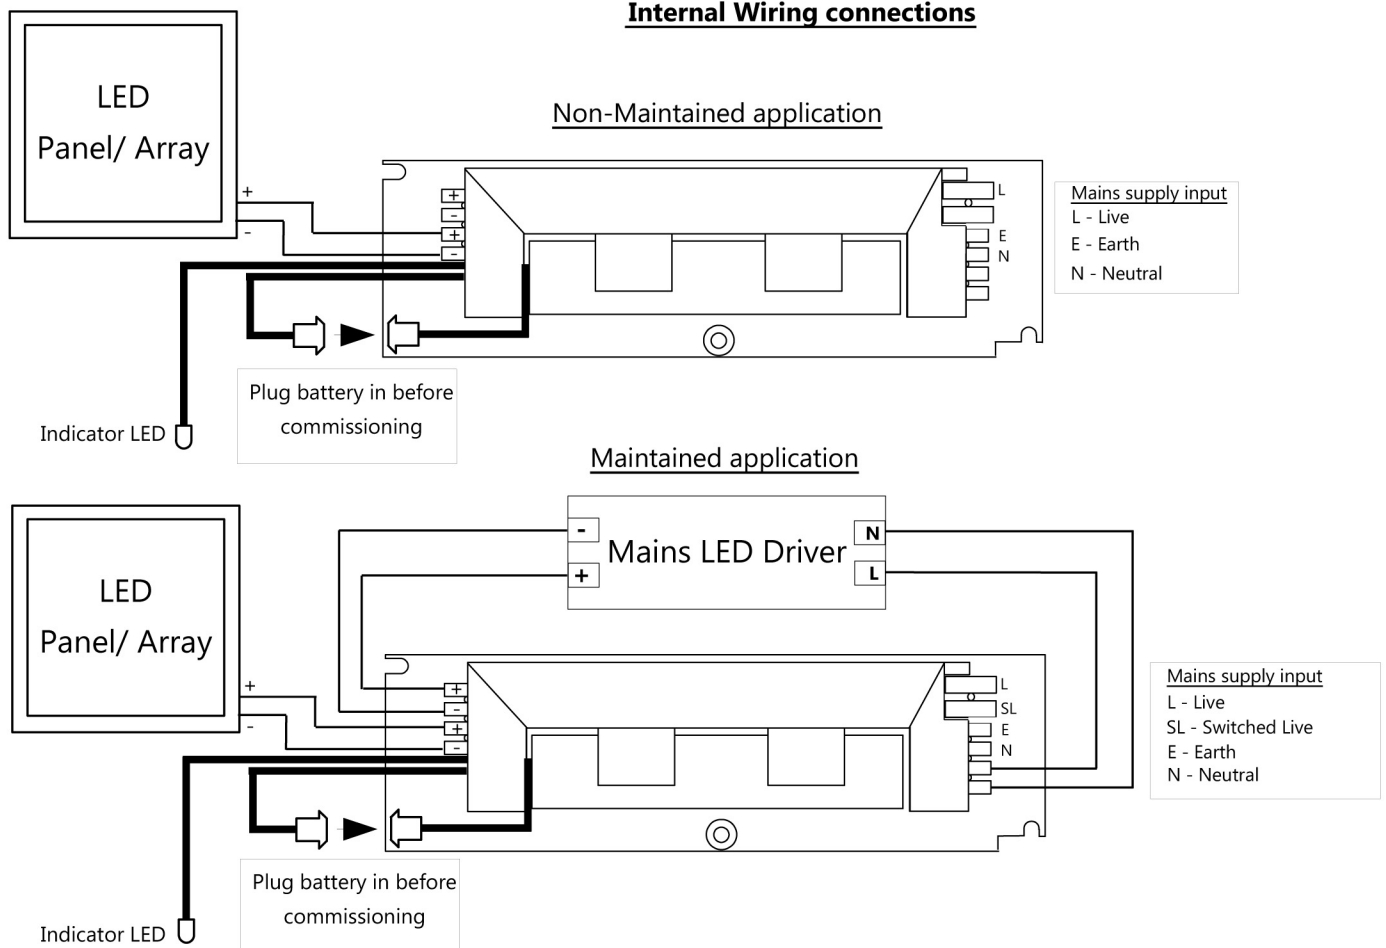

Emergency Installation and Inspection

Installation / Test Record	Serial / Luminaire Number:							
	Installed By:						Date:	
	Commissioned By:						Date:	

	Year 1		Year 2		Year 3		Year 4*	
Monthly test	Signed	Date	Signed	Date	Signed	Date	Signed	Date
1								
2								
3								
4								
5								
6								
7								
8								
9								
10								
11								
12								

*The battery must be replaced